


REVISIONS

REV.	DESCRIPTION	DATE	APPRVD.

Notes:

1. This unit produces acidic condensate during operation and must be drained and disposed according to local code. Use pipe material that will not corrode such as PVC or CPVC. Slope horizontal pipe downwards 1/4" per foot towards drain or condensate pump. Do not submerge or block end of drain pipe.

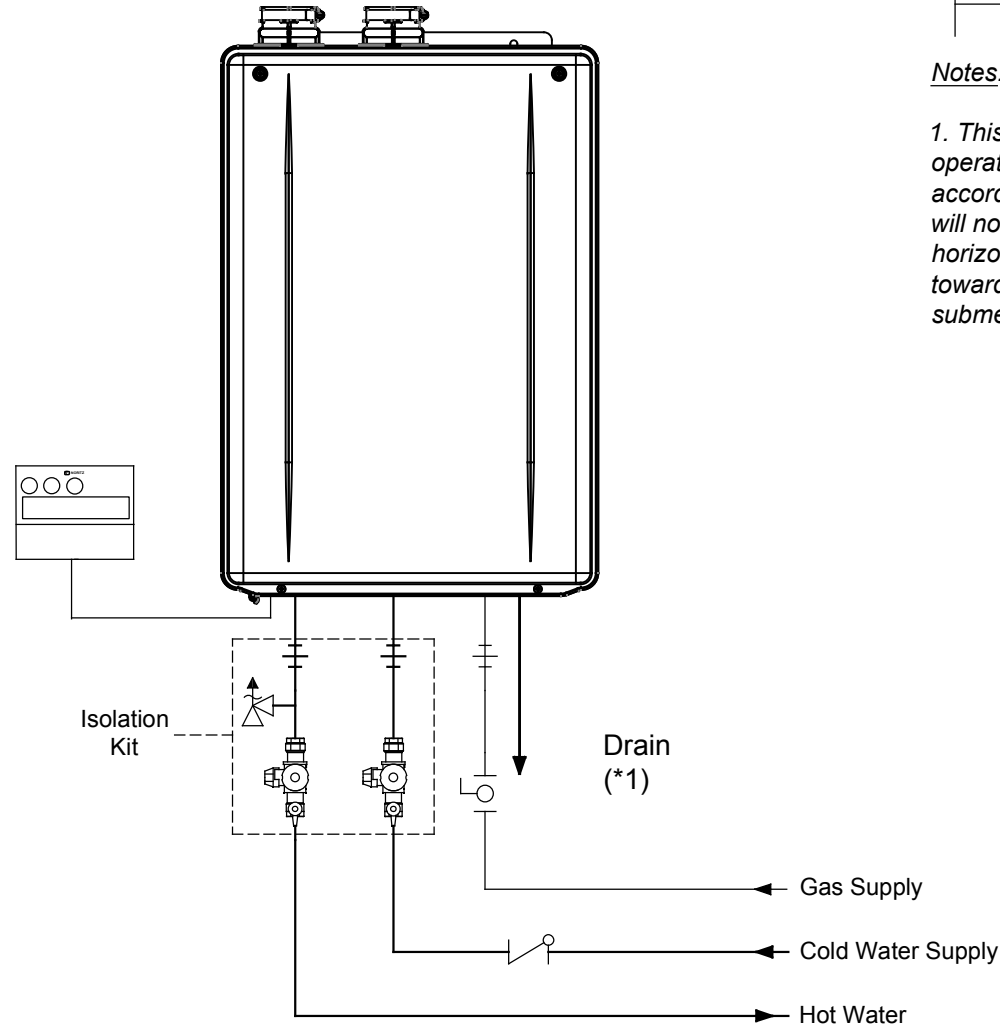

11160 Grace Avenue
Fountain Valley, California 92708
866-7NORITZ (866-766-7489)
www.noritz.com

MODEL:
Commercial Condensing

APPLICATION:
Domestic Hot Water

DRAWING NUMBER:
NCC-DHW

DRAWING DATE:
November 2018

Noritz Accessories



Isolation Kit w/ Pressure Relief
3/4" (# IK-WV-200-1-[TH or SW])
1" (# IK-WV-300-1-[TH or SW])



Commercial Neutralizer
(# NT-20A)

Note: *This diagram is for reference only. Installation must comply with State and Local Code, all gas and water pipe must be sized correctly to specific length, according to accepted engineering methods or the UPC Code for Noritz Water Heaters to operate correctly.*



Shut-off Ball Valve



Check Valve (optional)



Union



Pressure Relief Valve (Watts 174A,
Zurn P3000BR, Cash Acme FWL-82)



Aquastat (Honeywell Model
#L6006A or L6006C)



Pump



Mixing Valve



Thermal Expansion Tank